

Florida Building Code, Energy Conservation, 7th Edition (2020)

Mandatory Requirements for Residential Performance, Prescriptive and ERI Methods

ADDRESS: 8TH AVE NE
NAPLES, FL 34120

Permit Number:

MANDATORY REQUIREMENTS - See individual code sections for full details.

SECTION R401 GENERAL

- R401.3 Energy Performance Level (EPL) display card - (Mandatory).** The building official shall require that an energy performance level (EPL) display card be completed and certified by the builder to be accurate and correct before final approval of the building for occupancy. Florida law (Section 553.9085, Florida Statutes) requires the EPL display card to be included as an addendum to each sales contract for both presold and nonpresold residential buildings. The EPL display card contains information indicating the energy performance level and efficiencies of components installed in a dwelling unit. The building official shall verify that the EPL display card completed and signed by the builder accurately reflects the plans and specifications submitted to demonstrate code compliance for the building. A copy of the EPL display card can be found in Appendix RD.

SECTION R402 BUILDING THERMAL ENVELOPE

- R402.4 Air leakage (Mandatory).** The building thermal envelope shall be constructed to limit air leakage in accordance with the requirements of Sections R402.4.1 through R402.4.5.

Exception: Dwelling units of R-2 Occupancies and multiple attached single family dwellings shall be permitted to comply with Section C402.5.

- R402.4.1 Building thermal envelope.** The building thermal envelope shall comply with Sections R402.4.1.1 and R402.4.1.2. The sealing methods between dissimilar materials shall allow for differential expansion and contraction.
- R402.4.1.1 Installation.** The components of the building thermal envelope as listed in Table R402.4.1.1 shall be installed in accordance with the manufacturer's instructions and the criteria listed in Table R402.4.1.1, as applicable to the method of construction. Where required by the code official, an approved third party shall inspect all components and verify compliance.
- R402.4.1.2 Testing.** The building or dwelling unit shall be tested and verified as having an air leakage rate not exceeding seven air changes per hour in Climate Zones 1 and 2, and three air changes per hour in Climate Zones 3 through 8. Testing shall be conducted in accordance with ANSI/RESNET/ICC 380 and reported at a pressure of 0.2 inch w.g. (50 pascals). Testing shall be conducted by either individuals as defined in Section 553.993(5) or (7), Florida Statutes, or individuals licensed as set forth in Section 489.105(3)(f), (g) or (i) or an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the code official. Testing shall be performed at any time after creation of all penetrations of the building thermal envelope.

Exception: Testing is not required for additions, alterations, renovations, or repairs, of the building thermal envelope of existing buildings in which the new construction is less than 85 percent of the building thermal envelope.

During testing:

1. Exterior windows and doors, fireplace and stove doors shall be closed, but not sealed, beyond the intended weatherstripping or other infiltration control measures.
2. Dampers including exhaust, intake, makeup air, backdraft and flue dampers shall be closed, but not sealed beyond intended infiltration control measures.
3. Interior doors, if installed at the time of the test, shall be open.
4. Exterior doors for continuous ventilation systems and heat recovery ventilators shall be closed and sealed.
5. Heating and cooling systems, if installed at the time of the test, shall be turned off.
6. Supply and return registers, if installed at the time of the test, shall be fully open.

- R402.4.2 Fireplaces.** New wood-burning fireplaces shall have tight-fitting flue dampers or doors, and outdoor combustion air. Where using tight-fitting doors on factory-built fireplaces listed and labeled in accordance with UL 127, the doors shall be tested and listed for the fireplace. Where using tight-fitting doors on masonry fireplaces, the doors shall be listed and labeled in accordance with UL 907.
- R402.4.3 Fenestration air leakage.** Windows, skylights and sliding glass doors shall have an air infiltration rate of no more than 0.3 cfm per square foot (1.5 L/s/m²), and swinging doors no more than 0.5 cfm per square foot (2.6 L/s/m²), when tested according to NFRC 400 or AAMA/WDMA/CSA 101/I.S.2/A440 by an accredited, independent laboratory and listed and labeled by the manufacturer.

Exception: Site-built windows, skylights and doors.

- R402.4.4 Rooms containing fuel - burning appliances.** In Climate Zones 3 through 8, where open combustion air ducts provide combustion air to open combustion fuel burning appliances, the appliances and combustion air opening shall be located outside the building thermal envelope or enclosed in a room, isolated from inside the thermal envelope. Such rooms shall be sealed and insulated in accordance with the envelope requirements of Table R402.1.2, where the walls, floors and ceilings shall meet not less than the basement wall R-value requirement. The door into the room shall be fully gasketed and any water lines and ducts in the room insulated in accordance with Section R403. The combustion air duct shall be insulated where it passes through conditioned space to a minimum of R-8.

Exceptions:

1. Direct vent appliances with both intake and exhaust pipes installed continuous to the outside.
2. Fireplaces and stoves complying with Section R402.4.2 and Section R1006 of the Florida Building Code, Residential.

MANDATORY REQUIREMENTS (Continued)

- R402.4.5 Recessed lighting.** Recessed luminaires installed in the building thermal envelope shall be sealed to limit air leakage between conditioned and unconditioned spaces. All recessed luminaires shall be IC-rated and labeled as having an air leakage rate not more than 2.0 cfm (0.944 L/s) when tested in accordance with ASTM E283 at a 1.57 psf (75 Pa) pressure differential. All recessed luminaires shall be sealed with a gasket or caulk between the housing and the interior wall or ceiling covering.

SECTION R403 SYSTEMS

R403.1 Controls

- R403.1.1 Thermostat provision (Mandatory).** At least one thermostat shall be provided for each separate heating and cooling system
- R403.1.3 Heat pump supplementary heat (Mandatory).** Heat pumps having supplementary electric-resistance heat shall have controls that, except during defrost, prevent supplemental heat operation when the heat pump compressor can meet the heating load.

- R403.3.2 Sealing (Mandatory).** All ducts, air handlers, filter boxes and building cavities that form the primary air containment passageways for air distribution systems shall be considered ducts or plenum chambers, shall be constructed and sealed in accordance with Section C403.2.9.2 of the Commercial Provisions of this code and shall be shown to meet duct tightness criteria below.

Duct tightness shall be verified by testing in accordance with ANSI/RESNET/ICC 380 by either individuals as defined in Section 553.993(5) or (7), Florida Statutes, or individuals licensed as set forth in Section 489.105(3)(f), (g) or (i), Florida Statutes, to be "substantially leak free" in accordance with Section R403.3.3.

- R403.3.2.1 Sealed air handler.** Air handlers shall have a manufacturer's designation for an air leakage of no more than 2 percent of the design airflow rate when tested in accordance with ASHRAE 193.
- R403.3.3 Duct testing (Mandatory).** Ducts shall be pressure tested to determine air leakage by one of the following methods:
 1. Rough-in test: Total leakage shall be measured with a pressure differential of 0.1 inch w.g. (25 Pa) across the system, including the manufacturer's air handler enclosure if installed at the time of the test. All registers shall be taped or otherwise sealed during the test.
 2. Postconstruction test: Total leakage shall be measured with a pressure differential of 0.1 inch w.g. (25 Pa) across the entire system, including the manufacturer's air handler enclosure. Registers shall be taped or otherwise sealed during the test.**Exceptions;**
 1. A duct air leakage test shall not be required where the ducts and air handlers are located entirely within the building thermal envelope.
 2. Duct testing is not mandatory for buildings complying by Section 405 of this code. Duct leakage testing is required for Section R405 compliance where credit is taken for leakage, and a duct air leakage Q_n to the outside of less than 0.080 (where Q_n = duct leakage to the outside in cfm per 100 square feet of conditioned floor area tested at 25 Pascals) is indicated in the compliance report for the proposed design.A written report of the results of the test shall be signed by the party conducting the test and provided to the code official

- R403.3.5 Building cavities (Mandatory).** Building framing cavities shall not be used as ducts or plenums

- R403.4 Mechanical system piping insulation (Mandatory).** Mechanical system piping capable of carrying fluids above 105°F (41°C) or below 55°F (13°C) shall be insulated to a minimum of R-3.

- R403.4.1 Protection of piping insulation.** Piping insulation exposed to weather shall be protected from damage, including that caused by sunlight, moisture, equipment maintenance and wind, and shall provide shielding from solar radiation that can cause degradation of the material. Adhesive tape shall not be permitted.

- R403.5.1 Heated water circulation and temperature maintenance systems (Mandatory).** If heated water circulation systems are installed, they shall be in accordance with Section R403.5.1.1. Heat trace temperature maintenance systems shall be in accordance with Section R403.5.1.2. Automatic controls, temperature sensors and pumps shall be accessible. Manual controls shall be readily accessible.

- R403.5.1.1 Circulation systems.** Heated water circulation systems shall be provided with a circulation pump. The system return pipe shall be a dedicated return pipe or a cold water supply pipe. Gravity and thermosiphon circulation systems shall be prohibited. Controls for circulating hot water system pumps shall start the pump based on the identification of a demand for hot water within the occupancy. The controls shall automatically turn off the pump when the water in the circulation loop is at the desired temperature and when there is no demand for hot water.

- R403.5.1.2 Heat trace systems.** Electric heat trace systems shall comply with IEEE 515.1 or UL 515. Controls for such systems shall automatically adjust the energy input to the heat tracing to maintain the desired water temperature in the piping in accordance with the times when heated water is used in the occupancy.

MANDATORY REQUIREMENTS (Continued)

- R403.5.5 Heat traps (Mandatory).** Storage water heaters not equipped with integral heat traps and having vertical pipe risers shall have heat traps installed on both the inlets and outlets. External heat traps shall consist of either a commercially available heat trap or a downward and upward bend of at least 3 ½ inches (89 mm) in the hot water distribution line and cold water line located as close as possible to the storage tank.
- R403.5.6 Water heater efficiencies (Mandatory).**
 - R403.5.6.1.1 Automatic controls.** Service water-heating systems shall be equipped with automatic temperature controls capable of adjustment from the lowest to the highest acceptable temperature settings for the intended use. The minimum temperature setting range shall be from 100°F to 140°F (38°C to 60°C).
 - R403.5.6.1.2 Shut down.** A separate switch or a clearly marked circuit breaker shall be provided to permit the power supplied to electric service systems to be turned off. A separate valve shall be provided to permit the energy supplied to the main burner(s) of combustion types of service water-heating systems to be turned off.
 - R403.5.6.2 Water-heating equipment.** Water-heating equipment installed in residential units shall meet the minimum efficiencies of Table C404.2 in Chapter 4 of the Florida Building Code, Energy Conservation, Commercial Provisions, for the type of equipment installed. Equipment used to provide heating functions as part of a combination system shall satisfy all stated requirements for the appropriate water-heating category. Solar water heaters shall meet the criteria of Section R403.5.6.2.1.
 - R403.5.6.2.1 Solar water-heating systems.** Solar systems for domestic hot water production are rated by the annual solar energy factor of the system. The solar energy factor of a system shall be determined from the Florida Solar Energy Center Directory of Certified Solar Systems. Solar collectors shall be tested in accordance with ISO Standard 9806, Test Methods for Solar Collectors, and SRCC Standard TM-1, Solar Domestic Hot Water System and Component Test Protocol. Collectors in installed solar water-heating systems should meet the following criteria:
 1. Be installed with a tilt angle between 10 degrees and 40 degrees of the horizontal; and
 2. Be installed at an orientation within 45 degrees of true south.
- R403.6 Mechanical ventilation (Mandatory).** The building shall be provided with ventilation that meets the requirements of the Florida Building Code, Residential, or Florida Building Code, Mechanical, as applicable, or with other approved means of ventilation including: Natural, Infiltration or Mechanical means. Outdoor air intakes and exhausts shall have automatic or gravity dampers that close when the ventilation system is not operating.
 - R403.6.1 Whole-house mechanical ventilation system fan efficacy.** When installed to function as a whole-house mechanical ventilation system, fans shall meet the efficacy requirements of Table R403.6.1.

Exception: Where an air handler that is integral to tested and listed HVAC equipment is used to provide whole-house mechanical ventilation, the air handler shall be powered by an electronically commutated motor.
 - R403.6.2 Ventilation Air.** Residential buildings designed to be operated at a positive indoor pressure or for mechanical ventilation shall meet the following criteria:
 1. The design air change per hour minimums for residential buildings in ASHRAE 62.2, Ventilation for Acceptable Indoor Air Quality, shall be the maximum rates allowed for residential applications.
 2. No ventilation or air-conditioning system make-up air shall be provided to conditioned space from attics, crawlspaces, attached enclosed garages or outdoor spaces adjacent to swimming pools or spas.
 3. If ventilation air is drawn from enclosed space(s), then the walls of the space(s) from which air is drawn shall be insulated to a minimum of R-11 and the ceiling shall be insulated to a minimum of R-19, space permitting, or R-10 otherwise.
- R403.7 Heating and cooling equipment.**
 - R403.7.1 Equipment sizing (Mandatory).** Heating and cooling equipment shall be sized in accordance with ACCA Manual S based on the equipment loads calculated in accordance with ACCA Manual J or other approved heating and cooling calculation methodologies, based on building loads for the directional orientation of the building. The manufacturer and model number of the outdoor and indoor units (if split system) shall be submitted along with the sensible and total cooling capacities at the design conditions described in Section R302.1. This Code does not allow designer safety factors, provisions for future expansion or other factors that affect equipment sizing. System sizing calculations shall not include loads created by local intermittent mechanical ventilation such as standard kitchen and bathroom exhaust systems. New or replacement heating and cooling equipment shall have an efficiency rating equal to or greater than the minimum required by federal law for the geographic location where the equipment is installed.

MANDATORY REQUIREMENTS (Continued)

**TABLE R403.6.1
WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM FAN EFFICACY**

FAN LOCATION	AIRFLOW RATE MINIMUM (CFM)	MINIMUM EFFICACY ^a (CFM/WATT)	AIRFLOW RATE MAXIMUM (CFM)
HRV or ERV	Any	1.2 cfm/watt	Any
Rangehoods	Any	2.8 cfm/watt	Any
In-line fan	Any	2.8 cfm/watt	Any
Bathroom, utility room	10	1.4 cfm/watt	<90
Bathroom, utility room	90	2.8 cfm/watt	Any

For SI: 1 cfm = 28.3 L/min.

a. When tested in accordance with HVI Standard 916

- R403.7.1.1 Cooling equipment capacity.** Cooling only equipment shall be selected so that its total capacity is not less than the calculated total load but not more than 1.15 times greater than the total load calculated according to the procedure selected in Section R403.7, or the closest available size provided by the manufacturer's product lines. The corresponding latent capacity of the equipment shall not be less than the calculated latent load.
- The published value for AHRI total capacity is a nominal, rating-test value and shall not be used for equipment sizing. Manufacturer's expanded performance data shall be used to select cooling-only equipment. This selection shall be based on the outdoor design dry-bulb temperature for the load calculation (or entering water temperature for water-source equipment), the blower CFM provided by the expanded performance data, the design value for entering wet-bulb temperature and the design value for entering dry-bulb temperature.

Design values for entering wet-bulb and dry-bulb temperatures shall be for the indoor dry bulb and relative humidity used for the load calculation and shall be adjusted for return side gains if the return duct(s) is installed in an unconditioned space.

Exceptions:

1. Attached single- and multiple-family residential equipment sizing may be selected so that its cooling capacity is less than the calculated total sensible load but not less than 80 percent of that load.
2. When signed and sealed by a Florida-registered engineer, in attached single- and multiple-family units, the capacity of equipment may be sized in accordance with good design practice.

R403.7.1.2 Heating equipment capacity.

- R403.7.1.2.1 Heat pumps.** Heat pump sizing shall be based on the cooling requirements as calculated according to Section R403.7.1.1, and the heat pump total cooling capacity shall not be more than 1.15 times greater than the design cooling load even if the design heating load is 1.15 times greater than the design cooling load.

- R403.7.1.2.2 Electric resistance furnaces.** Electric resistance furnaces shall be sized within 4 kW of the design requirements calculated according to the procedure selected in Section R403.7.1.

- R403.7.1.2.3 Fossil fuel heating equipment.** The capacity of fossil fuel heating equipment with natural draft atmospheric burners shall not be less than the design load calculated in accordance with Section R403.7.1.

- R403.7.1.3 Extra capacity required for special occasions.** Residences requiring excess cooling or heating equipment capacity on an intermittent basis, such as anticipated additional loads caused by major entertainment events, shall have equipment sized or controlled to prevent continuous space cooling or heating within that space by one or more of the following options:

1. A separate cooling or heating system is utilized to provide cooling or heating to the major entertainment areas.
2. A variable capacity system sized for optimum performance during base load periods is utilized.

- R403.8 Systems serving multiple dwelling units (Mandatory).** Systems serving multiple dwelling units shall comply with Sections C403 and C404 of the Florida Building Code, Energy Conservation—Commercial Provisions in lieu of Section R403.

- R403.9 Snow melt and ice system controls (Mandatory).** Snow- and ice-melting systems, supplied through energy service to the building, shall include automatic controls capable of shutting off the system when the pavement temperature is above 50°F (10°C), and no precipitation is falling and an automatic or manual control that will allow shutoff when the outdoor temperature is above 40°F (4.8°C).

- 403.10 Pools and permanent spa energy consumption (Mandatory).** The energy consumption of pools and permanent spas shall be in accordance with Sections R403.10.1 through R403.10.5.

- R403.10.1 Heaters.** The electric power to heaters shall be controlled by a readily accessible on-off switch that is an integral part of the heater mounted on the exterior of the heater, or external to and within 3 feet (914 mm) of the heater. Operation of such switch shall not change the setting of the heater thermostat. Such switches shall be in addition to a circuit breaker for the power to the heater.
- Gas-fired heaters shall not be equipped with continuously burning ignition pilots.

MANDATORY REQUIREMENTS (Continued)

- R403.10.2 Time switches.** Time switches or other control methods that can automatically turn off and on according to a preset schedule shall be installed for heaters and pump motors. Heaters and pump motors that have built-in time switches shall be in compliance with this section.

Exceptions:

1. Where public health standards require 24-hour pump operation.
2. Pumps that operate solar- and waste-heat-recovery pool heating systems
3. Where pumps are powered exclusively from on-site renewable generation.

- R403.10.3 Covers.** Outdoor heated swimming pools and outdoor permanent spas shall be equipped with a vapor-retardant cover on or at the water surface or a liquid cover or other means proven to reduce heat loss.

Exception: Where more than 70 percent of the energy for heating, computed over an operation season, is from site-recovered energy, such as from a heat pump or solar energy source, covers or other vapor-retardant means shall not be required

- R403.10.4 Gas- and oil-fired pool and spa heaters.** All gas- and oil-fired pool and spa heaters shall have a minimum thermal efficiency of 82 percent for heaters manufactured on or after April 16, 2013, when tested in accordance with ANSI Z 21.56. Pool heaters fired by natural or LP gas shall not have continuously burning pilot lights.

- R403.10.5 Heat pump pool heaters.** Heat pump pool heaters shall have a minimum COP of 4.0 when tested in accordance with AHRI 1160, Table 2, Standard Rating Conditions-Low Air Temperature. A test report from an independent laboratory is required to verify procedure compliance. Geothermal swimming pool heat pumps are not required to meet this standard.

- R403.11 Portable spas (Mandatory).** The energy consumption of electric-powered portable spas shall be controlled by the requirements of APSP-14

- R403.13 Dehumidifiers (Mandatory).** If installed, a dehumidifier shall conform to the following requirements:

1. The minimum rated efficiency of the dehumidifier shall be greater than 1.7 liters/ kWh if the total dehumidifier capacity for the house is less than 75 pints/day and greater than 2.38 liters/kWh if the total dehumidifier capacity for the house is greater than or equal to 75 pints/day.
2. The dehumidifier shall be controlled by a sensor that is installed in a location where it is exposed to mixed house air.
3. Any dehumidifier unit located in unconditioned space that treats air from conditioned space shall be insulated to a minimum of R-2.
4. Condensate disposal shall be in accordance with Section M1411.3.1 of the Florida Building Code, Residential.

- R403.13.1 Ducted dehumidifiers.** Ducted dehumidifiers shall, in addition to conforming to the requirements of Section R403.13, conform to the following requirements:

1. If a ducted dehumidifier is configured with return and supply ducts both connected into the supply side of the cooling system, a backdraft damper shall be installed in the supply air duct between the dehumidifier inlet and outlet duct.
2. If a ducted dehumidifier is configured with only its supply duct connected into the supply side of the central heating and cooling system, a backdraft damper shall be installed in the dehumidifier supply duct between the dehumidifier and central supply duct.
3. A ducted dehumidifier shall not be ducted to or from a central ducted cooling system on the return duct side upstream from the central cooling evaporator coil.
4. Ductwork associated with a dehumidifier located in unconditioned space shall be insulated to a minimum of R-6.

SECTION R404 ELECTRICAL POWER AND LIGHTING SYSTEMS

- R404.1 Lighting equipment (Mandatory).** Not less than 90 percent of the lamps in permanently installed luminaires shall have an efficacy of at least 45 lumens-per-watt or shall utilize lamps with an efficacy of not less than 65 lumens-per-watt.

R404.1.1 Lighting equipment (Mandatory). Fuel gas lighting systems shall not have continuously burning pilot lights.

**2020 - AIR BARRIER AND INSULATION INSPECTION COMPONENT CRITERIA
TABLE 402.4.1.1**

AIR BARRIER AND INSULATION INSPECTION COMPONENT CRITERIA^a

Project Name: EOS - 8TH AVE NE 40627080007		Builder Name:		CHECK
Street: 8TH AVE NE		Permit Office:		
City, State, Zip: NAPLES, FL, 34120		Permit Number:		
Owner: ALAMO INVESTS PROPERTIES LLC		Jurisdiction:		
Design Location: FL, Lee/Collier		County: Collier(Florida Climate Zone 1)		
COMPONENT	AIR BARRIER CRITERIA	INSULATION INSTALLATION CRITERIA		
General requirements	A continuous air barrier shall be installed in the building envelope. The exterior thermal envelope contains a continuous air barrier. Breaks or joints in the air barrier shall be sealed.	Air-permeable insulation shall not be used as a sealing material.		
Ceiling/attic	The air barrier in any dropped ceiling/soffit shall be aligned with the insulation and any gaps in the air barrier shall be sealed. Access openings, drop down stairs or knee wall doors to unconditioned attic spaces shall be sealed.	The insulation in any dropped ceiling/soffit shall be aligned with the air barrier.		
Walls	The junction of the foundation and sill plate shall be sealed. The junction of the top plate and the top of exterior walls shall be sealed. Knee walls shall be sealed.	Cavities within corners and headers of frame walls shall be insulated by completely filling the cavity with a material having a thermal resistance of R-3 per inch minimum Exterior thermal envelope insulation for framed walls shall be installed in substantial contact and continuous alignment with the air barrier.		
Windows, skylights and doors	The space between window/door jambs and framing, and skylights and framing shall be sealed.			
Rim joists	Rim joists shall include the air barrier.	Rim joists shall be insulated.		
Floors (including above-garage and cantilevered floors)	The air barrier shall be installed at any exposed edge of insulation.	Floor framing cavity insulation shall be installed to maintain permanent contact with the underside of subfloor decking, or floor framing cavity insulation shall be permitted to be in contact with the top side of sheathing, or continuous insulation installed on the underside of floor framing and extends from the bottom to the top of all perimeter floor framing members.		
Crawl space walls	Exposed earth in unvented crawl spaces shall be covered with a Class I vapor retarder with overlapping joints taped.	Where provided instead of floor insulation, insulation shall be permanently attached to the crawlspace walls.		
Shafts, penetrations	Duct shafts, utility penetrations, and flue shafts opening to exterior or unconditioned space shall be sealed.			
Narrow cavities		Batts in narrow cavities shall be cut to fit, or narrow cavities shall be filled by insulation that on installation readily conforms to the available cavity spaces.		
Garage separation	Air sealing shall be provided between the garage and conditioned spaces.			
Recessed lighting	Recessed light fixtures installed in the building thermal envelope shall be sealed to the finished surface.	Recessed light fixtures installed in the building thermal envelope shall be air tight and IC rated.		
Plumbing and wiring		Batt insulation shall be cut neatly to fit around wiring and plumbing in exterior walls, or insulation that on installation readily conforms to available space shall extend behind piping and wiring.		
Shower/tub on exterior wall	The air barrier installed at exterior walls adjacent to showers and tubs shall separate them from the showers and tubs.	Exterior walls adjacent to showers and tubs shall be insulated.		
Electrical/phone box on exterior walls	The air barrier shall be installed behind electrical or communication boxes or air-sealed boxes shall be installed.			
HVAC register boots	HVAC supply and return register boots that penetrate building thermal envelope shall be sealed to the sub-floor, wall covering or ceiling penetrated by the boot.			
Concealed sprinklers	When required to be sealed, concealed fire sprinklers shall only be sealed in a manner that is recommended by the manufacturer. Caulking or other adhesive sealants shall not be used to fill voids voids between fire sprinkler cover plates and walls or ceilings.			

a. In addition, inspection of log walls shall be in accordance with the provisions of ICC-400.

INPUT SUMMARY CHECKLIST REPORT

PROJECT										
Title:	EOS - 8TH AVE NE 40627080007				Address type:	Street Address				
Building Type:	User	Bedrooms:	3		Lot #:	---				
Owner:	ALAMO INVESTS PROPERTIES LLC	ConditionedArea:	1630		Block/SubDivision:	---				
Builder Name:		Total Stories:	1		PlatBook:	---				
Permit Office:		Worst Case:	No		Street:	8TH AVE NE				
Jurisdiction:		RotateAngle:	0		County:	Collier				
Family Type:	Detached	Cross Ventilation:			City, State, Zip:	NAPLES, FL, 34120				
New/Existing:	New (From Plans)	Whole House Fan:								
Year Construct:		Terrain:	Suburban							
Comment:		Shielding:	Suburban							
CLIMATE										
<input checked="" type="checkbox"/> Design Location	Tmy Site	Design Temp	97.5%	2.5%	Int Design Temp	Heating DegreeDays	Design Moisture	Dailytemp Range		
___ FL, Lee/Collier	FL_SOUTHWEST_FLORIDA_I	46	91	70	75	321	58	Medium		
UTILITY										
<input checked="" type="checkbox"/> Fuel	Unit	UtilityName				Monthly Fixed Cost	\$/Unit			
___ Electricity	kWh	EnergyGaugeDefault				0.00	0.13			
___ Natural Gas	Therm	EnergyGaugeDefault				0.00	0.68			
___ Fuel Oil	Gallon	EnergyGaugeDefault				0.00	1.10			
___ Propane	Gallon	EnergyGaugeDefault				0.00	1.40			
SURROUNDINGS										
Ornt	Type	-----Shade Trees-----			Exist	-----Adjacent Buildings-----				
		Height	Width	Distance		Height	Width	Distance		
N	None	0 ft	0 ft	0 ft		0 ft	0 ft	0 ft		
NE	None	0 ft	0 ft	0 ft		0 ft	0 ft	0 ft		
E	None	0 ft	0 ft	0 ft		0 ft	0 ft	0 ft		
SE	None	0 ft	0 ft	0 ft		0 ft	0 ft	0 ft		
S	None	0 ft	0 ft	0 ft		0 ft	0 ft	0 ft		
SW	None	0 ft	0 ft	0 ft		0 ft	0 ft	0 ft		
W	None	0 ft	0 ft	0 ft		0 ft	0 ft	0 ft		
NW	None	0 ft	0 ft	0 ft		0 ft	0 ft	0 ft		
BLOCKS										
<input checked="" type="checkbox"/> Number	Name	Area	Volume							
___ 1	Block1	1630	16300							
SPACES										
<input checked="" type="checkbox"/> Number	Name	Area	Volume	Kitchen	Occupants	Bedrooms	Finished	Cooled	Heated	
___ 1	Main	1630	16300	Yes	4	3	Yes	Yes	Yes	
FLOORS (Total Exposed Area = 1630 sq.ft.)										
<input checked="" type="checkbox"/> #	FloorType	Space	ExposedPerim	PerimeterR-Value	Area	U-Factor	JoistR-Value	Tile	Wood	Carpet

INPUT SUMMARY CHECKLIST REPORT

FLOORS(Continued)

✓ #	FloorType	Space	ExposedPerim	PerimeterR-Value	Area	U-Factor	JoistR-Value	Tile	Wood	Carpet
___ 1	Slab-On-Grade Edge Ins	Main	180	0	1630 ft	0.304	---	0.00	0.00	1.00

ROOF

✓ #	Type	Materials	Roof Area	Gable Area	Roof Color	Rad Barr	Solar Absor.	SA Tested	Emitt Tested	Emitt Tested	Deck Insul.	Pitch (deg)
___ 1	Hip	Compositionshingles	1766 ft²	0 ft²	Medium	N	0.96	No	0.9	No	0	22.62

ATTIC

✓ #	Type	Ventilation	Vent Ratio (1 in)	Area	RBS	IRCC
___ 1	Full attic	Vented	300	1630 ft²	N	N

CEILING

(Total Exposed Area = 1630 sq.ft.)

✓ #	CeilingType	Space	R-Value	Ins. Type	Area	U-Factor	FramingFrac.	Truss Type
___ 1	UnderAttic(Vented)	Main	30.0	Batt	1630.0ft²	0.064	0.11	Wood

WALLS

(Total Exposed Area = 1788 sq.ft.)

✓ #	Ornt	Adjacent To	Wall Type	Space	Cavity R-Value	Width Ft	In	Height Ft	In	Area sq.ft.	U-Factor	Sheath R-Value	Frm. Frac.	Solar Absor.	Below Grade
___ 1	N	Garage	Frame - Wood	Main	19.0	19.0	0	10.0	0	190.0	0.065	0.9	0.23	0.75	0 %
___ 2	N	Exterior	Conc. Blk - Int Ins	Main	4.1	28.0	4	10.0	0	283.3	0.128	1.11	0	0.75	0 %
___ 3	S	Exterior	Conc. Blk - Int Ins	Main	4.1	47.0	4	10.0	0	473.3	0.128	1.11	0	0.75	0 %
___ 4	W	Exterior	Conc. Blk - Int Ins	Main	4.1	42.0	1	10.0	0	420.8	0.128	1.11	0	0.75	0 %
___ 5	E	Exterior	Conc. Blk - Int Ins	Main	4.1	42.0	1	10.0	0	420.8	0.128	1.11	0	0.75	0 %

DOORS

(Total Exposed Area = 58 sq.ft.)

✓ #	Ornt	Adjacent To	Door Type	Space	Storms	U-Value	Width Ft	In	Height Ft	In	Area
___ 1	S	Garage	Wood	Main	None	0.46	2.00	8	6.00	8	17.8ft²
___ 2	N	Exterior	Insulated	Main	None	0.46	5.00	0	8.00	0	40.0ft²

WINDOWS

(Total Exposed Area = 179 sq.ft.)

✓ #	Ornt	Wall ID	Frame	Panes	NFRC	U-Factor	SHGC	Imp	Storm	Total Area (ft²)	Same Units	Width (ft)	Height (ft)	--Overhang-- Depth (ft)	Sep. (ft)	InteriorShade	Screen
___ 1	N	2	Metal	Single(Clear)	Y	0.60	0.30	N	N	16.2	1	3.08	5.25	0.0	0.0	None	None
___ 2	N	2	Metal	Single(Clear)	Y	0.60	0.30	N	N	16.2	1	3.08	5.25	0.0	0.0	None	None
___ 3	S	3	Metal	Single(Clear)	Y	0.60	0.30	N	N	16.2	1	3.08	5.25	0.0	0.0	None	None
___ 4	S	3	Metal	Single(Clear)	Y	0.60	0.30	N	N	5.1	1	2.25	2.25	0.0	0.0	None	None
___ 5	S	3	Metal	Single(Clear)	Y	0.60	0.30	N	N	16.2	1	3.08	5.25	0.0	0.0	None	None
___ 6	S	3	Metal	Single(Clear)	Y	0.60	0.30	N	N	16.2	1	3.08	5.25	0.0	0.0	None	None
___ 7	W	4	Metal	Single(Clear)	Y	0.60	0.30	N	N	5.1	1	2.25	2.25	0.0	0.0	None	None
___ 8	W	4	Metal	Single(Clear)	Y	0.60	0.30	N	N	16.2	1	3.08	5.25	0.0	0.0	None	None
___ 9	E	5	Metal	Single(Clear)	Y	0.60	0.30	N	N	8.0	1	6.00	1.33	0.0	0.0	None	None

INPUT SUMMARY CHECKLIST REPORT

WINDOWS(Continued)

__ 10S	3	Metal	Single(Clear)	Y	1.12	0.50	N	N	64.0	1	8.00	8.00	1.3	0.0	None	None
--------	---	-------	---------------	---	------	------	---	---	------	---	------	------	-----	-----	------	------

INFILTRATION

√ #	Scope	Method	SLA	CFM50	ELA	EqLA	ACH	ACH50	Space(s)
__ 1	Wholehouse	Proposed ACH(50)	0.00044	1902	104.33	195.87	0.1460	7.0	All

GARAGE

√ #	Floor Area	Roof Area	Exposed Wall Perimeter	Avg. Wall Height	Exposed Wall Insulation
__ 1	379 ft²	379 ft²	57 ft	10 ft	1

MASS

√ #	Mass Type	Area	Thickness	Furniture Fraction	Space
__ 1	Default(8 lbs/sq.ft.)	0 ft²	0 ft	0.30	Main

HEATING SYSTEM

√ #	System Type	Subtype/Speed	AHRI #	Efficiency	Capacity kBtu/hr	----GeothermalHeatPump----			Ducts	Block
						Entry	Power	Volt	Current	
__ 1	Electric Heat Pump	None/Single		HSPF: 16.00	18.0	0.00	0.00	0.00		sys#1 1
__ 1A	Electric Heat Pump	None/		HSPF: 15.00	20.0	0.00	0.00	0.00		sys#1 1

COOLING SYSTEM

√ #	System Type	Subtype/Speed	AHRI #	Efficiency	Capacity kBtu/hr	Air Flow cfm	SHR	Duct	Block
__ 1	Central Unit	None/Single		SEER:16.0	36.0	1080	0.75	sys#1	1
__ 1A	Central Unit	None/Single		SEER:15.0	36.0	1080	0.75	sys#1	1

AHU SYSTEM

√ #	Test Mode	System Number & Type (Proposed)	Grade	DESIGN CFM Cool	Heat	Proposed
__ 1		1 - Central Unit/1 - Electric Heat Pump	III (AirFlow) III (WattDraw) III (Refrig) III (Duct) Duct System # 1	1080	__	__

HOT WATER SYSTEM

√ #	System Type	Subtype	Location	EF(UEF)	Cap	Use	SetPnt	Fixture Flow	Pipe Ins.	Pipe length
__ 1	Electric	None	Garage	0.92 (0.92)	40.00 gal	60 gal	120 deg	Standard	None	88
	Recirculation System	Recirc Control Type	Loop length	Branch length	Pump power	DWHR	Facilities Connected	Equal Flow	DWHR Eff	Other Credits
__ 1	No		NA	NA	NA	No	NA	NA	NA	None

INPUT SUMMARY CHECKLIST REPORT

DUCTS															
√ Duct #	-----Supply----- Location	R-Value	Area	-----Return----- Location	R-Value	Area	LeakageType	Air Handler	CFM 25 TOT	CFM 25 OUT	QN	RLF	HVAC # Heat Cool		
___ 1	Main	6.0	302 ft²	Main	6.0	76 ft²	DefaultLeakage	Attic	(Default)	(Default)			1	1	
TEMPERATURES															
Programable Thermostat: N					Ceiling Fans: N										
Cooling	<input type="checkbox"/> Jan	<input type="checkbox"/> Feb	<input type="checkbox"/> Mar	<input type="checkbox"/> Apr	<input type="checkbox"/> May	<input checked="" type="checkbox"/> Jun	<input checked="" type="checkbox"/> Jul	<input checked="" type="checkbox"/> Aug	<input checked="" type="checkbox"/> Sep	<input type="checkbox"/> Oct	<input type="checkbox"/> Nov	<input type="checkbox"/> Dec			
Heating	<input checked="" type="checkbox"/> Jan	<input checked="" type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input type="checkbox"/> Apr	<input type="checkbox"/> May	<input type="checkbox"/> Jun	<input type="checkbox"/> Jul	<input type="checkbox"/> Aug	<input type="checkbox"/> Sep	<input type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input checked="" type="checkbox"/> Dec			
Venting	<input type="checkbox"/> Jan	<input type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input checked="" type="checkbox"/> Apr	<input type="checkbox"/> May	<input type="checkbox"/> Jun	<input type="checkbox"/> Jul	<input type="checkbox"/> Aug	<input type="checkbox"/> Sep	<input checked="" type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input type="checkbox"/> Dec			
√ Thermostat Schedule: HERS 2006 Reference	Schedule Type	Hours													
		1	2	3	4	5	6	7	8	9	10	11	12		
___ Cooling (WD)	AM PM	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	
___ Cooling (WEH)	AM PM	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	
___ Heating (WD)	AM PM	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	
___ Heating (WEH)	AM PM	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	
REFRIGERATORS															
√ ID	Type	Screen	Location	Quantity	Vol	Frz. Vol	Make	Model	Schedule	kWhPerYr					
___ 1	DefaultRefrigerator	Default New	Main	1	26	5			HERS2011						
CLOTHES WASHERS															
√ ID	Type	Screen	Location	Capacity	Make	Model	Schedule	LoadsPerYr							
___ 1	Cl washer	Default New	Main	2.874			HERS2011	312							
CLOTHES DRYERS															
√ ID	Type	Screen	Location	Quantity	Fuel Type	Make	Model	Schedule	kWhPerYr						
___ 1	Dryer	Default Existing	Main	4.5	Electricity			HERS2011	314						
DISHWASHERS															
√ ID	Type	Screen	Location	Capacity	Vintage	Make	Model	Schedule	kWhPerYr						
___ 1	Dishwasher	Default New	Main	12	2013 or Newer			HERS2011	372						
HARD WIRED LIGHTING															
√ ID	Type	Screen	Location	Total#	Quantity#	Comp FI	All Other FI	Bulb Type	Schedule	Watts per bulb					

INPUT SUMMARY CHECKLIST REPORT

MISC ELECTRICAL LOADS

√ ID	Type	Screen	Location	Item	Quantity	Category	Operating	Schedule	Off Standby
___ 1	Misc Elec Load	SimpleDefault	Main		1		1	HERS2011	1

Name(Print): _____

Signature: _____

Organization: _____

Date: _____

FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION

Florida Department of Business and Professional Regulation - Residential Performance Method

Project Name: EOS - 8TH AVE NE 40627080007 Street: 8TH AVE NE City, State, Zip: NAPLES, FL, 34120 Owner: ALAMO INVESTS PROPERTIES LLC Design Location: FL, Lee/Collier	Builder Name: Permit Office: Permit Number: Jurisdiction: County: Collier(Florida Climate Zone 1)
--	---

<table style="width:100%; border-collapse: collapse;"> <tr> <td style="width:30%;">1. New construction or existing</td> <td style="width:30%;">New (From Plans)</td> <td style="width:40%;"></td> </tr> <tr> <td>2. Single family or multiple family</td> <td>Detached</td> <td></td> </tr> <tr> <td>3. Number of units, if multiple family</td> <td>1</td> <td></td> </tr> <tr> <td>4. Number of Bedrooms</td> <td>3</td> <td></td> </tr> <tr> <td>5. Is this a worst case?</td> <td>No</td> <td></td> </tr> <tr> <td>6. Conditioned floor area above grade (ft²)</td> <td>1630</td> <td></td> </tr> <tr> <td> Conditioned floor area below grade (ft²)</td> <td>0</td> <td></td> </tr> <tr> <td>7. Windows(179.3 sqft.)</td> <td>Description</td> <td>Area</td> </tr> <tr> <td> a. U-Factor:</td> <td>Sgl, U=0.60</td> <td>115.25 ft²</td> </tr> <tr> <td> SHGC:</td> <td>SHGC=0.30</td> <td></td> </tr> <tr> <td> b. U-Factor:</td> <td>Sgl, U=1.12</td> <td>64.00 ft²</td> </tr> <tr> <td> SHGC:</td> <td>SHGC=0.50</td> <td></td> </tr> <tr> <td> c. U-Factor:</td> <td>N/A</td> <td>ft²</td> </tr> <tr> <td> SHGC:</td> <td></td> <td></td> </tr> <tr> <td colspan="2">Area Weighted Average Overhang Depth:</td> <td>0.476 ft</td> </tr> <tr> <td colspan="2">Area Weighted Average SHGC:</td> <td>0.371</td> </tr> <tr> <td>8. Skylights</td> <td>Description</td> <td>Area</td> </tr> <tr> <td> U-Factor:(AVG)</td> <td>N/A</td> <td>N/A ft²</td> </tr> <tr> <td> SHGC(AVG):</td> <td>N/A</td> <td></td> </tr> <tr> <td>9. Floor Types</td> <td>Insulation</td> <td>Area</td> </tr> <tr> <td> a. Slab-On-Grade Edge Insulation</td> <td>R= 0.0</td> <td>1630.00 ft²</td> </tr> <tr> <td> b. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td> c. N/A</td> <td>R=</td> <td>ft²</td> </tr> </table>	1. New construction or existing	New (From Plans)		2. Single family or multiple family	Detached		3. Number of units, if multiple family	1		4. Number of Bedrooms	3		5. Is this a worst case?	No		6. Conditioned floor area above grade (ft ²)	1630		Conditioned floor area below grade (ft ²)	0		7. Windows(179.3 sqft.)	Description	Area	a. U-Factor:	Sgl, U=0.60	115.25 ft ²	SHGC:	SHGC=0.30		b. U-Factor:	Sgl, U=1.12	64.00 ft ²	SHGC:	SHGC=0.50		c. U-Factor:	N/A	ft ²	SHGC:			Area Weighted Average Overhang Depth:		0.476 ft	Area Weighted Average SHGC:		0.371	8. Skylights	Description	Area	U-Factor:(AVG)	N/A	N/A ft ²	SHGC(AVG):	N/A		9. Floor Types	Insulation	Area	a. Slab-On-Grade Edge Insulation	R= 0.0	1630.00 ft ²	b. N/A	R=	ft ²	c. N/A	R=	ft ²	<table style="width:100%; border-collapse: collapse;"> <tr> <td style="width:30%;">10. Wall Types(1788.3 sqft.)</td> <td style="width:30%;">Insulation</td> <td style="width:40%;">Area</td> </tr> <tr> <td> a. Concrete Block - Int Insul, Exterior</td> <td>R=4.1</td> <td>1598.30 ft²</td> </tr> <tr> <td> b. Frame - Wood, Adjacent</td> <td>R=19.0</td> <td>190.00 ft²</td> </tr> <tr> <td> c. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td> d. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td>11. Ceiling Types(1630.0 sqft.)</td> <td>Insulation</td> <td>Area</td> </tr> <tr> <td> a. Under Attic (Vented)</td> <td>R=30.0</td> <td>1630.00 ft²</td> </tr> <tr> <td> b. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td> c. N/A</td> <td>R=</td> <td>ft²</td> </tr> <tr> <td>12. Ducts, location & insulation level</td> <td></td> <td>R</td> </tr> <tr> <td> a. Sup: Main, Ret: Main, AH: Attic</td> <td></td> <td>6 302.4</td> </tr> <tr> <td> b.</td> <td></td> <td></td> </tr> <tr> <td> c.</td> <td></td> <td></td> </tr> <tr> <td>13. Cooling Systems</td> <td>kBtu/hr</td> <td>Efficiency</td> </tr> <tr> <td> a. Central Unit</td> <td>36.0</td> <td>SEER:16.00</td> </tr> <tr> <td>14. Heating Systems</td> <td>kBtu/hr</td> <td>Efficiency</td> </tr> <tr> <td> a. Electric Heat Pump</td> <td>18.0</td> <td>HSPF:16.00</td> </tr> <tr> <td>15. Hot Water Systems</td> <td></td> <td></td> </tr> <tr> <td> a. Electric</td> <td></td> <td>Cap: 40 gallons</td> </tr> <tr> <td></td> <td></td> <td>EF: 0.920</td> </tr> <tr> <td> b. Conservation features</td> <td></td> <td></td> </tr> <tr> <td></td> <td></td> <td>None</td> </tr> <tr> <td>16. Credits</td> <td></td> <td>None</td> </tr> </table>	10. Wall Types(1788.3 sqft.)	Insulation	Area	a. Concrete Block - Int Insul, Exterior	R=4.1	1598.30 ft ²	b. Frame - Wood, Adjacent	R=19.0	190.00 ft ²	c. N/A	R=	ft ²	d. N/A	R=	ft ²	11. Ceiling Types(1630.0 sqft.)	Insulation	Area	a. Under Attic (Vented)	R=30.0	1630.00 ft ²	b. N/A	R=	ft ²	c. N/A	R=	ft ²	12. Ducts, location & insulation level		R	a. Sup: Main, Ret: Main, AH: Attic		6 302.4	b.			c.			13. Cooling Systems	kBtu/hr	Efficiency	a. Central Unit	36.0	SEER:16.00	14. Heating Systems	kBtu/hr	Efficiency	a. Electric Heat Pump	18.0	HSPF:16.00	15. Hot Water Systems			a. Electric		Cap: 40 gallons			EF: 0.920	b. Conservation features					None	16. Credits		None
1. New construction or existing	New (From Plans)																																																																																																																																										
2. Single family or multiple family	Detached																																																																																																																																										
3. Number of units, if multiple family	1																																																																																																																																										
4. Number of Bedrooms	3																																																																																																																																										
5. Is this a worst case?	No																																																																																																																																										
6. Conditioned floor area above grade (ft ²)	1630																																																																																																																																										
Conditioned floor area below grade (ft ²)	0																																																																																																																																										
7. Windows(179.3 sqft.)	Description	Area																																																																																																																																									
a. U-Factor:	Sgl, U=0.60	115.25 ft ²																																																																																																																																									
SHGC:	SHGC=0.30																																																																																																																																										
b. U-Factor:	Sgl, U=1.12	64.00 ft ²																																																																																																																																									
SHGC:	SHGC=0.50																																																																																																																																										
c. U-Factor:	N/A	ft ²																																																																																																																																									
SHGC:																																																																																																																																											
Area Weighted Average Overhang Depth:		0.476 ft																																																																																																																																									
Area Weighted Average SHGC:		0.371																																																																																																																																									
8. Skylights	Description	Area																																																																																																																																									
U-Factor:(AVG)	N/A	N/A ft ²																																																																																																																																									
SHGC(AVG):	N/A																																																																																																																																										
9. Floor Types	Insulation	Area																																																																																																																																									
a. Slab-On-Grade Edge Insulation	R= 0.0	1630.00 ft ²																																																																																																																																									
b. N/A	R=	ft ²																																																																																																																																									
c. N/A	R=	ft ²																																																																																																																																									
10. Wall Types(1788.3 sqft.)	Insulation	Area																																																																																																																																									
a. Concrete Block - Int Insul, Exterior	R=4.1	1598.30 ft ²																																																																																																																																									
b. Frame - Wood, Adjacent	R=19.0	190.00 ft ²																																																																																																																																									
c. N/A	R=	ft ²																																																																																																																																									
d. N/A	R=	ft ²																																																																																																																																									
11. Ceiling Types(1630.0 sqft.)	Insulation	Area																																																																																																																																									
a. Under Attic (Vented)	R=30.0	1630.00 ft ²																																																																																																																																									
b. N/A	R=	ft ²																																																																																																																																									
c. N/A	R=	ft ²																																																																																																																																									
12. Ducts, location & insulation level		R																																																																																																																																									
a. Sup: Main, Ret: Main, AH: Attic		6 302.4																																																																																																																																									
b.																																																																																																																																											
c.																																																																																																																																											
13. Cooling Systems	kBtu/hr	Efficiency																																																																																																																																									
a. Central Unit	36.0	SEER:16.00																																																																																																																																									
14. Heating Systems	kBtu/hr	Efficiency																																																																																																																																									
a. Electric Heat Pump	18.0	HSPF:16.00																																																																																																																																									
15. Hot Water Systems																																																																																																																																											
a. Electric		Cap: 40 gallons																																																																																																																																									
		EF: 0.920																																																																																																																																									
b. Conservation features																																																																																																																																											
		None																																																																																																																																									
16. Credits		None																																																																																																																																									

Glass/Floor Area:0.110	Total Proposed Modified Loads: 54.78	PASS
	Total Baseline Loads: 57.32	

<p>I hereby certify that the plans and specifications covered by this calculation are in compliance with the Florida Energy Code.</p> <p>PREPARED BY: _____</p> <p>DATE: <u>11/22/21</u></p> <div style="text-align: center;"> </div> <p>I hereby certify that this building, as designed, is in compliance with the Florida Energy Code.</p> <p>OWNER/AGENT: _____</p> <p>DATE: <u>11/25/2021</u></p>	<p>Review of the plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed this building will be inspected for compliance with Section 553.908 Florida Statutes.</p> <div style="text-align: center;"> </div> <p>BUILDING OFFICIAL: _____</p> <p>DATE: _____</p>
--	---

- Compliance requires certification by the air handler unit manufacturer that the air handler enclosure qualifies as certified factory-sealed in accordance with R403.3.2.1.
- Default duct leakage does not require a Duct Leakage Test Report.
- Compliance requires an Air Barrier and Insulation Inspection Checklist in accordance with R402.4.1.1 and this project requires a PERFORMANCE envelope leakage test report with envelope leakage no greater than 7.00 ACH50 (R402.4.1.2).

INPUT SUMMARY CHECKLIST REPORT**PROJECT**

Title:	EOS - 8TH AVE NE 40627080007	Address type:	Street Address		
Building Type:	User	Bedrooms:	3	Lot #:	---
Owner:	ALAMO INVESTS PROPERTIES LLC	ConditionedArea:	1630	Block/SubDivision:	---
		Total Stories:	1	PlatBook:	---
BuilderName:		Worst Case:	No	Street:	8TH AVE NE
Permit Office:		RotateAngle:	0	County:	Collier
Jurisdiction:		Cross Ventilation:		City, State, Zip:	NAPLES, FL, 34120
Family Type:	Detached	Whole House Fan:			
New/Existing:	New (From Plans)	Terrain:	Suburban		
Year Construct:		Shielding:	Suburban		
Comment:					

CLIMATE

✓ Design Location	Tmy Site	Design Temp		Int Design Temp		Heating DegreeDays	Design Moisture	Dailytemp Range
		97.5%	2.5%	Winter	Summer			
___ FL, Lee/Collier	FL_SOUTHWEST_FLORIDA_I	46	91	70	75	321	58	Medium

BLOCKS

✓ Number	Name	Area	Volume
___ 1	Block1	1630	16300

SPACES

✓ Number	Name	Area	Volume	Kitchen	Occupants	Bedrooms	Finished	Cooled	Heated
___ 1	Main	1630	16300	Yes	4	3	Yes	Yes	Yes

FLOORS

(Total Exposed Area = 1630 sq.ft.)

✓ #	FloorType	Space	ExposedPerim	PerimeterR-Value	Area	U-Factor	JoistR-Value	Tile	Wood	Carpet
___ 1	Slab-On-Grade Edge Ins	Main	180	0	1630 ft	0.304	---	0.00	0.00	1.00

ROOF

✓ #	Type	Materials	Roof Area	Gable Area	Roof Color	Rad Barr	Solar Absor.	SA Tested	Emitt	Emitt Tested	Deck Insul.	Pitch (deg)
___ 1	Hip	Compositionshingles	1766 ft²	0 ft²	Medium	N	0.96	No	0.9	No	0	22.62

ATTIC

✓ #	Type	Ventilation	Vent Ratio (1 in)	Area	RBS	IRCC
___ 1	Full attic	Vented	300	1630 ft²	N	N

CEILING

(Total Exposed Area = 1630 sq.ft.)

✓ #	CeilingType	Space	R-Value	Ins. Type	Area	U-Factor	FramingFrac.	Truss Type
___ 1	UnderAttic(Vented)	Main	30.0	Batt	1630.0ft²	0.064	0.11	Wood

INPUT SUMMARY CHECKLIST REPORT

WALLS														(Total Exposed Area = 1788 sq.ft.)	
✓ #	Ornt	Adjacent To	Wall Type	Space	Cavity R-Value	Width Ft	In	Height Ft	In	Area sq.ft.	U-Factor	Sheath R-Value	Frm. Frac.	Solar Absor.	Below Grade
___ 1	N	Garage	Frame - Wood	Main	19.0	19.0	0	10.0	0	190.0	0.065	0.9	0.23	0.75	0 %
___ 2	N	Exterior	Conc. Blk - Int Ins	Main	4.1	28.0	4	10.0	0	283.3	0.128	1.11	0	0.75	0 %
___ 3	S	Exterior	Conc. Blk - Int Ins	Main	4.1	47.0	4	10.0	0	473.3	0.128	1.11	0	0.75	0 %
___ 4	W	Exterior	Conc. Blk - Int Ins	Main	4.1	42.0	1	10.0	0	420.8	0.128	1.11	0	0.75	0 %
___ 5	E	Exterior	Conc. Blk - Int Ins	Main	4.1	42.0	1	10.0	0	420.8	0.128	1.11	0	0.75	0 %

DOORS												(Total Exposed Area = 58 sq.ft.)	
✓ #	Ornt	Adjacent To	Door Type	Space	Storms	U-Value	Width Ft	In	Height Ft	In	Area		
___ 1	S	Garage	Wood	Main	None	0.46	2.00	8	6.00	8	17.8ft²		
___ 2	N	Exterior	Insulated	Main	None	0.46	5.00	0	8.00	0	40.0ft²		

WINDOWS																(Total Exposed Area = 179 sq.ft.)	
✓ #	Ornt	Wall ID	Frame	Panes	NFRC U-Factor	SHGC	Imp	Storm	Total Area (ft²)	Same Units	Width (ft)	Height (ft)	--Overhang-- Depth (ft)	Sep. (ft)	Interior Shade	Screen	
___ 1	N	2	Metal	Single (Clear)	Y	0.60	0.30	N	N	16.2	1	3.08	5.25	0.0	0.0	None	None
___ 2	N	2	Metal	Single (Clear)	Y	0.60	0.30	N	N	16.2	1	3.08	5.25	0.0	0.0	None	None
___ 3	S	3	Metal	Single (Clear)	Y	0.60	0.30	N	N	16.2	1	3.08	5.25	0.0	0.0	None	None
___ 4	S	3	Metal	Single (Clear)	Y	0.60	0.30	N	N	5.1	1	2.25	2.25	0.0	0.0	None	None
___ 5	S	3	Metal	Single (Clear)	Y	0.60	0.30	N	N	16.2	1	3.08	5.25	0.0	0.0	None	None
___ 6	S	3	Metal	Single (Clear)	Y	0.60	0.30	N	N	16.2	1	3.08	5.25	0.0	0.0	None	None
___ 7	W	4	Metal	Single (Clear)	Y	0.60	0.30	N	N	5.1	1	2.25	2.25	0.0	0.0	None	None
___ 8	W	4	Metal	Single (Clear)	Y	0.60	0.30	N	N	16.2	1	3.08	5.25	0.0	0.0	None	None
___ 9	E	5	Metal	Single (Clear)	Y	0.60	0.30	N	N	8.0	1	6.00	1.33	0.0	0.0	None	None
___ 10	S	3	Metal	Single (Clear)	Y	1.12	0.50	N	N	64.0	1	8.00	8.00	1.3	0.0	None	None

INFILTRATION									
✓ #	Scope	Method	SLA	CFM50	ELA	EqLA	ACH	ACH50	Space(s)
___ 1	Wholehouse	Proposed ACH(50)	0.00044	1902	104.33	195.87	0.1460	7.0	All

GARAGE					
✓ #	Floor Area	Roof Area	Exposed Wall Perimeter	Avg. Wall Height	Exposed Wall Insulation
___ 1	379 ft²	379 ft²	57 ft	10 ft	1

MASS					
✓ #	Mass Type	Area	Thickness	Furniture Fraction	Space
___ 1	Default(8 lbs/sq.ft.)	0 ft²	0 ft	0.30	Main

HEATING SYSTEM											
✓ #	System Type	Subtype/Speed	AHRI #	Efficiency	Capacity kBtu/hr	----GeothermalHeatPump----			Ducts	Block	
						Entry	Power	Volt	Current		
___ 1	Electric Heat Pump	None/Single		HSPF: 16.00	18.0	0.00	0.00	0.00	0.00	sys#1	1

INPUT SUMMARY CHECKLIST REPORT

HEATING SYSTEM(Continued)

1A Electric Heat Pump None/ HSPF: 15.00 20.0 0.00 0.00 0.00 sys#1 1

COOLING SYSTEM

✓ #	System Type	Subtype/Speed	AHRI #	Efficiency	Capacity kBtu/hr	Air Flow cfm	SHR	Duct	Block
<input type="checkbox"/> 1	Central Unit	None/Single		SEER:16.0	36.0	1080	0.75	sys#1	1
<input type="checkbox"/> 1A	Central Unit	None/Single		SEER:15.0	36.0	1080	0.75	sys#1	1

HOT WATER SYSTEM

✓ #	System Type	Subtype	Location	EF(UEF)	Cap	Use	SetPnt	FixtureFlow	Pipe Ins.	Pipe length
<input type="checkbox"/> 1	Electric	None	Garage	0.92 (0.92)	40.00 gal	60 gal	120 deg	Standard	None	88
	Recirculation System	Recirc Control Type	Loop length	Branch length	Pump power	DWHR	Facilities Connected	Equal Flow	DWHR Eff	Other Credits
<input type="checkbox"/> 1	No		NA	NA	NA	No	NA	NA	NA	None

DUCTS

✓ Duct #	Location	Supply R-Value	Area	Return R-Value	Area	Leakage Type	Air Handler	CFM 25 TOT	CFM 25 OUT	QN	RLF	HVAC # Heat	HVAC # Cool
<input type="checkbox"/> 1	Main	6.0	302 ft²	6.0	76 ft²	DefaultLeakage	Attic	(Default)	(Default)			1	1

TEMPERATURES

Programable Thermostat: N Ceiling Fans: N
 Cooling Jan Feb Mar Apr May Jun Jul Aug Sep Oct Nov Dec
 Heating Jan Feb Mar Apr May Jun Jul Aug Sep Oct Nov Dec
 Venting Jan Feb Mar Apr May Jun Jul Aug Sep Oct Nov Dec

✓ Thermostat Schedule: HERS 2006 Reference	Schedule Type	1	2	3	4	5	6	7	8	9	10	11	12
<input type="checkbox"/> Cooling (WD)	AM PM	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78
<input type="checkbox"/> Cooling (WEH)	AM PM	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78	78 78
<input type="checkbox"/> Heating (WD)	AM PM	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68
<input type="checkbox"/> Heating (WEH)	AM PM	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68	68 68

ENERGY PERFORMANCE LEVEL (EPL) DISPLAY CARD

ESTIMATED ENERGY PERFORMANCE INDEX* = 96

The lower the EnergyPerformance Index, the more efficient the home.

8TH AVE NE,NAPLES,FL,34120

<p>1. New construction or existing New (From Plans)</p> <p>2. Single family or multiple family Detached</p> <p>3. Number of units, if multiple family 1</p> <p>4. Number of Bedrooms 3</p> <p>5. Is this a worst case? No</p> <p>6. Conditioned floor area above grade (ft²) 1630 Conditioned floor area below grade (ft²) 0</p> <p>7. Windows** Description Area</p> <p> a. U-Factor: Sgl, U=0.60 115.25 ft² SHGC: SHGC=0.30</p> <p> b. U-Factor: Sgl, U=1.12 64.00 ft² SHGC: SHGC=0.50</p> <p> c. U-Factor: N/A ft² SHGC:</p> <p> Area Weighted Average Overhang Depth: 0.476 ft Area Weighted Average SHGC: 0.371</p> <p>8. Skylights Description Area</p> <p> U-Factor:(AVG) N/A N/A ft² SHGC(AVG): N/A</p> <p>9. Floor Types Insulation Area</p> <p> a. Slab-On-Grade Edge Insulation R= 0.0 1630.00 ft² b. N/A R= ft² c. N/A R= ft²</p>	<p>10. Wall Types(1788.3 sqft.) Insulation Area</p> <p> a. Concrete Block - Int Insul, ExteriorR=4.1 1598.30 ft² b. Frame - Wood, Adjacent R=19.0 190.00 ft² c. N/A R= ft² d. N/A R= ft²</p> <p>11. Ceiling Types(1630.0 sqft.) Insulation Area</p> <p> a. Under Attic (Vented) R=30.0 1630.00 ft² b. N/A R= ft² c. N/A R= ft²</p> <p>12. Ducts, location & insulation level R ft²</p> <p> a. Sup: Main, Ret: Main, AH: Attic 6 302.4 b. c.</p> <p>13. Cooling Systems kBtu/hr Efficiency</p> <p> a. Central Unit 36.0 SEER:16.00</p> <p>14. Heating Systems kBtu/hr Efficiency</p> <p> a. Electric Heat Pump 18.0 HSPF:16.00</p> <p>15. Hot Water Systems</p> <p> a. Electric Cap: 40 gallons EF: 0.920</p> <p> b. Conservation features None</p> <p>16. Credits None</p>
--	--

I certify that this home has complied with the Florida Energy Efficiency Code for Building Construction through the above energy saving features which will be installed (or exceeded) in this home before final inspection. Otherwise, a new EPL Display Card will be completed based on installed Code compliant features.

Builder Signature: _____ Date: _____

Address of New Home: 8TH AVE NE City/FL Zip: NAPLES,FL,34120



*Note: This is not a Building Energy Rating. If your Index is below 70, your home may qualify for energy efficient mortgage (EEM) incentives if you obtain a Florida Energy Rating. For information about the Florida Building Code, Energy Conservation, contact the Florida Building Commission's support staff.

**Label required by Section R303.1.3 of the Florida Building Code, Energy Conservation, if not DEFAULT.

Residential System Sizing Calculation

Summary

ALAMO INVESTS PROPERTIES LLC
8TH AVE NE
NAPLES, FL 34120

Project Title:
EOS - 8TH AVE NE 40627080007


11/22/2021

Location for weather data: Lee/Collier, FL - Defaults: Latitude(26.53) Altitude(15 ft.) Temp Range(M)					
Humidity data: Interior RH (50%) Outdoor wet bulb (78F) Humidity difference(58gr.)					
Winter design temperature(TMY3 99%)	43	F	Summer design temperature(TMY3 99%)	93	F
Winter setpoint	70	F	Summer setpoint	75	F
Winter temperature difference	27	F	Summer temperature difference	18	F
Total heating load calculation	18653	Btuh	Total cooling load calculation	34302	Btuh
Submitted heating capacity	% of calc	Btuh	Submitted cooling capacity	% of calc	Btuh
Total (Electric Heat Pump)	96.5	18000	Sensible (SHR = 0.75)	103.0	27000
Heat Pump + Auxiliary(0.0kW)	96.5	18000	Latent	111.4	9000
			Total (Electric Heat Pump)	105.0	36000

WINTER CALCULATIONS

Winter Heating Load (for 1630 sqft)


Load component	Load	
Window total	179 sqft	3802 Btuh
Wall total	1551 sqft	5113 Btuh
Door total	58 sqft	718 Btuh
Ceiling total	1630 sqft	1402 Btuh
Floor total	1630 sqft	5735 Btuh
Infiltration	63 cfm	1884 Btuh
Duct loss		0 Btuh
Subtotal		18653 Btuh
Ventilation	Ex:0 cfm; Sup:0 cfm	0 Btuh
TOTAL HEAT LOSS		18653 Btuh

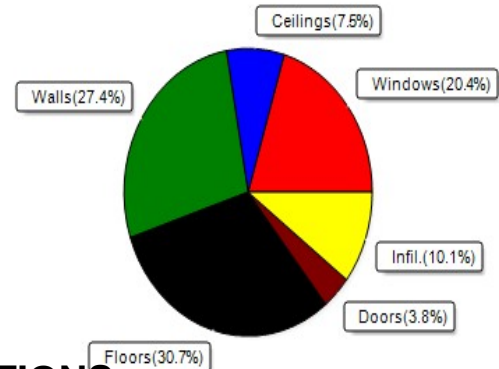

SUMMER CALCULATIONS

Summer Cooling Load (for 1630 sqft)

Load component	Load	
Window total	179 sqft	4699 Btuh
Wall total	1551 sqft	3461 Btuh
Door total	58 sqft	771 Btuh
Ceiling total	1630 sqft	2232 Btuh
Floor total		0 Btuh
Infiltration	48 cfm	942 Btuh
Internal gain		14120 Btuh
Duct gain		0 Btuh
Sens.Ventilation	Ex:0 cfm; Sup:0 cfm	0 Btuh
Blower Load		0 Btuh
Total sensible gain		26225 Btuh
Latent gain(ducts)		0 Btuh
Latent gain(infiltration)		1877 Btuh
Latent gain(ventilation)		0 Btuh
Latent gain(internal/occupants/other)		6200 Btuh
Total latent gain		8077 Btuh
TOTAL HEAT GAIN		34302 Btuh

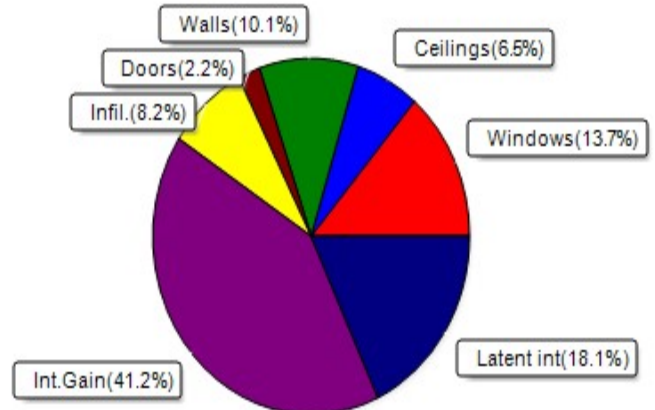

8th Edition

EnergyGauge® System Sizing

PREPARED BY: _____

DATE: _____

System Sizing Calculations - Summer

Residential Load - Whole House Component Details

ALAMO INVESTS PROPERTIES LLC
8TH AVE NE
NAPLES, FL 34120

Project Title:
EOS - 8TH AVE NE 40627080007

11/22/2021

Reference City: Lee/Collier, FL (Defaults)
Humidity difference: 58gr.

Temperature Difference: 18.0F(TMY3 99%)
Summer Setpoint: 75 °F (Required Manual J default)

Component Loads for Whole House

Window	Type*						Overhang		Window Area(sqft)			HTM		Load
	Panes	SHGC	U	InSh	IS	Ornt	Len	Hgt	Gross	Shaded	Unshaded	Shaded	Unshaded	
1	1 NFRC	0.30, 0.60	No	No	N	0.0ft.	0.0ft.	16.2	0.0	16.2	17	17	280 Btuh	
2	1 NFRC	0.30, 0.60	No	No	N	0.0ft.	0.0ft.	16.2	0.0	16.2	17	17	280 Btuh	
3	1 NFRC	0.30, 0.60	No	No	S	0.0ft.	0.0ft.	16.2	0.0	16.2	17	18	299 Btuh	
4	1 NFRC	0.30, 0.60	No	No	S	0.0ft.	0.0ft.	5.1	0.0	5.1	17	18	93 Btuh	
5	1 NFRC	0.30, 0.60	No	No	S	0.0ft.	0.0ft.	16.2	0.0	16.2	17	18	299 Btuh	
6	1 NFRC	0.30, 0.60	No	No	S	0.0ft.	0.0ft.	16.2	0.0	16.2	17	18	299 Btuh	
7	1 NFRC	0.30, 0.60	No	No	W	0.0ft.	0.0ft.	5.1	0.0	5.1	17	40	202 Btuh	
8	1 NFRC	0.30, 0.60	No	No	W	0.0ft.	0.0ft.	16.2	0.0	16.2	17	40	647 Btuh	
9	1 NFRC	0.30, 0.60	No	No	E	0.0ft.	0.0ft.	8.0	0.0	8.0	17	40	320 Btuh	
10	1 NFRC	0.50, 1.12	No	No	S	1.3ft.	0.0ft.	64.0	64.0	0.0	31	33	1980 Btuh	
Window Total								179 (sqft)					4699 Btuh	
Walls	Type	U-Value	R-Value	Area(sqft)		HTM		Load						
						Cav/Sheath								
1	Frame - Wood - Adj	0.07	19.0/0.9	172.2		1.3		230 Btuh						
2	ConcreteBlk,Hollow - Ext	0.13	4.1/1.1	211.0		2.3		494 Btuh						
3	ConcreteBlk,Hollow - Ext	0.13	4.1/1.1	355.7		2.3		833 Btuh						
4	ConcreteBlk,Hollow - Ext	0.13	4.1/1.1	399.6		2.3		936 Btuh						
5	ConcreteBlk,Hollow - Ext	0.13	4.1/1.1	412.8		2.3		967 Btuh						
Wall Total				1551 (sqft)				3461 Btuh						
Doors	Type	Area (sqft)		HTM		Load								
1	Wood - Garage	17.8		13.3		237 Btuh								
2	Insulated - Exterior	40.0		13.3		534 Btuh								
Door Total		58 (sqft)				771 Btuh								
Ceilings	Type/Color/Surface	U-Value	R-Value	Area(sqft)	HTM		Load							
1	Vented Attic/Light/Shingle	0.032	30.0/0.0	1630.0	1.37		2232 Btuh							
Ceiling Total				1630 (sqft)			2232 Btuh							
Floors	Type	R-Value		Size	HTM		Load							
1	Slab On Grade	0.0		1630 (ft-perimeter)	0.0		0 Btuh							
Floor Total				1630.0 (sqft)			0 Btuh							
Envelope Subtotal:							11163 Btuh							
Infiltration	Type	Average ACH	Volume(cuft)	Wall Ratio	CFM=		Load							
	Natural	0.18	16300	1	47.6		942 Btuh							
Internal gain	Occupants	Btuh/occupant		Appliance		Load								
	4	X	230	+	13200		14120 Btuh							
Sensible Envelope Load:							26225 Btuh							
Duct load	Averagesealed, Supply(R6.0-Cond), Return(R6.0-Cond)				(DGM of 0.000)		0 Btuh							
Sensible Load All Zones							26225 Btuh							

Manual J Summer Calculations

Residential Load - Component Details (continued)

ALAMO INVESTS PROPERTIES LLC
8TH AVE NE
NAPLES, FL 34120

Project Title: Climate:FL_SOUTHWEST_FLORIDA_I
EOS - 8TH AVE NE 40627080007

11/22/2021


WHOLE HOUSE TOTALS

Whole House Totals for Cooling	Sensible Envelope Load All Zones	26225 Btuh
	Sensible Duct Load	0 Btuh
	Total Sensible Zone Loads	26225 Btuh
	Sensible ventilation (Ex:0 cfm; Sup:0 cfm)	0 Btuh
	Blower	0 Btuh
	Total sensible gain	26225 Btuh
	Latent infiltration gain (for 58 gr. humidity difference)	1877 Btuh
	Latent ventilation gain	0 Btuh
	Latent duct gain	0 Btuh
	Latent occupant gain (4.0 people @ 200 Btuh per person)	800 Btuh
	Latent other gain	5400 Btuh
	Latent total gain	8077 Btuh
TOTAL GAIN	34302 Btuh	

EQUIPMENT

1. Central Unit	Multiple #Multiple	36000 Btuh
-----------------	--------------------	------------

*Key: Window types (Panels - Number and type of panes of glass)
(SHGC - Shading coefficient of glass as SHGC numerical value)
(U - Window U-Factor)
(InSh - Interior shading device: none(No), Blinds(B), Draperies(D) or Roller Shades(R))
- For Blinds: Assume medium color, half closed
For Draperies: Assume medium weave, half closed
For Roller shades: Assume translucent, half closed
(IS - Insect screen: none(N), Full(F) or Half(½))
(Ornt - compass orientation)



Version 8

System Sizing Calculations - Winter

Residential Load - Whole House Component Details

ALAMO INVESTS PROPERTIES LLC
8TH AVE NE
NAPLES, FL 34120

Project Title:
EOS - 8TH AVE NE 40627080007
Building Type: User

11/22/2021

Reference City: Lee/Collier, FL (Defaults) Winter Temperature Difference: 27.0 °F (TMY3 99%)
Winter Setpoint: 70 °F (Required Manual J default)

Component Loads for Whole House								
Window	Panes/Type	Frame	U	Orientation	Area(sqft)	X	HTM=	Load
1	1, NFRC 0.30	Metal	0.60	N	16.2		16.2	262 Btuh
2	1, NFRC 0.30	Metal	0.60	N	16.2		16.2	262 Btuh
3	1, NFRC 0.30	Metal	0.60	S	16.2		16.2	262 Btuh
4	1, NFRC 0.30	Metal	0.60	S	5.1		16.2	82 Btuh
5	1, NFRC 0.30	Metal	0.60	S	16.2		16.2	262 Btuh
6	1, NFRC 0.30	Metal	0.60	S	16.2		16.2	262 Btuh
7	1, NFRC 0.30	Metal	0.60	W	5.1		16.2	82 Btuh
8	1, NFRC 0.30	Metal	0.60	W	16.2		16.2	262 Btuh
9	1, NFRC 0.30	Metal	0.60	E	8.0		16.2	130 Btuh
10	1, NFRC 0.50	Metal	1.12	S	64.0		30.2	1935 Btuh
Window Total					179.3(sqft)			3802 Btuh
Walls	Type	Ornt.	Ueff.	R-Value (Cav/Sh)	Area	X	HTM=	Load
1	Frame - Wood	- Adj	(0.074)	19.0/0.9	172		2.01	345 Btuh
2	Conc Blk,Hollow	- Ext	(0.128)	4.1/1.1	211		3.46	729 Btuh
3	Conc Blk,Hollow	- Ext	(0.128)	4.1/1.1	356		3.46	1230 Btuh
4	Conc Blk,Hollow	- Ext	(0.128)	4.1/1.1	400		3.46	1381 Btuh
5	Conc Blk,Hollow	- Ext	(0.128)	4.1/1.1	413		3.46	1427 Btuh
Wall Total					1551(sqft)			5113 Btuh
Doors	Type	Storm	Ueff.		Area	X	HTM=	Load
1	Wood - Garage,	n	(0.460)		18		12.4	221 Btuh
2	Insulated - Exterior,	n	(0.460)		40		12.4	497 Btuh
Door Total					58(sqft)			718Btuh
Ceilings	Type/Color/Surface	Ueff.	R-Value		Area	X	HTM=	Load
1	Vented Attic/L/Shing	(0.032)	30.0/0.0		1630		0.9	1402 Btuh
Ceiling Total					1630(sqft)			1402Btuh
Floors	Type	Ueff.	R-Value		Size	X	HTM=	Load
1	Slab On Grade	(1.180)	0.0		180.0 ft(perim.)		31.9	5735 Btuh
Floor Total					1630 sqft			5735 Btuh
Envelope Subtotal:								16769 Btuh
Infiltration	Type	Wholehouse	ACH	Volume(cuft)	Wall Ratio	CFM=		Load
	Natural		0.23	16300	1.00	63.5		1884 Btuh
Duct load	Average sealed, R6.0, Supply(Con), Return(Con)						(DLM of 0.000)	0 Btuh
All Zones	Sensible Subtotal All Zones							18653 Btuh

Manual J Winter Calculations

Residential Load - Component Details (continued)

ALAMO INVESTS PROPERTIES LLC
8TH AVE NE
NAPLES, FL 34120

Project Title:
EOS - 8TH AVE NE 40627080007
Building Type: User

11/22/2021

WHOLE HOUSE TOTALS

Totals for Heating	Subtotal Sensible Heat Loss	18653 Btuh
	Ventilation Sens. Heat Loss (Ex:0 cfm; Sup:0 cfm)	0 Btuh
	Total Heat Loss	18653 Btuh

EQUIPMENT

1. Electric Heat Pump	Multiple #Multiple	18000 Btuh
-----------------------	--------------------	------------

Key: Window types - NFRC (Requires U-Factor and Shading coefficient(SHGC) of glass as numerical values)
or - Glass as 'Clear' or 'Tint' (Uses U-Factor and SHGC defaults)
U - (Window U-Factor)
HTM - (ManualJ Heat Transfer Multiplier)



Version 8

Envelope Leakage Test Report (Blower Door Test)

Residential Prescriptive, Performance or ERI Method Compliance

2020 Florida Building Code, Energy Conservation, 7th Edition

Jurisdiction:	Permit #:
---------------	-----------

Job Information

Builder:	Community:	Lot: NA
Address: 8TH AVE NE		
City: NAPLES	State: FL	Zip: 34120

Air Leakage Test Results *Passing results must meet either the Performance, Prescriptive, or ERI Method*

PRESCRIPTIVE METHOD-The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding 7 air changes per hour at a pressure of 0.2 inch w.g. (50 Pascals) in Climate Zones 1 and 2.

PERFORMANCE or ERI METHOD-The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding the selected ACH(50) value, as shown on Form R405-2020 (Performance) or R406-2020 (ERI), section labeled as infiltration, sub-section ACH50.
 ACH(50) specified on Form R405-2020-Energy Calc (Performance) or R406-2020 (ERI): 7.000

$\frac{\text{CFM}(50)}{\text{Building Volume}} \times 60 \div \frac{16300}{\text{ACH}(50)} = \text{ACH}(50)$ <div style="text-align: center; margin: 10px 0;"> <input type="checkbox"/> PASS </div> <p><input type="checkbox"/> When ACH(50) is less than 3, Mechanical Ventilation installation must be verified by building department.</p>	<p><u>Method for calculating building volume:</u></p> <p><input type="radio"/> Retrieved from architectural plans</p> <p><input checked="" type="radio"/> Code software calculated</p> <p><input type="radio"/> Field measured and calculated</p>
--	---

R402.4.1.2 Testing. Testing shall be conducted in accordance with ANSI/RESNET/ICC 380 and reported at a pressure of 0.2 inch w.g. (50 Pascals). Testing shall be conducted by either individuals as defined in Section 553.993(5) or (7), *Florida Statutes* or individuals licensed as set forth in Section 489.105(3)(f), (g), or (i) or an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the *code official*. Testing shall be performed at any time after creation of all penetrations of the *building thermal envelope*.

During testing:

1. Exterior windows and doors, fireplace and stove doors shall be closed, but not sealed, beyond the intended weatherstripping or other infiltration control measures.
2. Dampers including exhaust, intake, makeup air, back draft and flue dampers shall be closed, but not sealed beyond intended infiltration control measures.
3. Interior doors, if installed at the time of the test, shall be open.
4. Exterior doors for continuous ventilation systems and heat recovery ventilators shall be closed and sealed.
5. Heating and cooling systems, if installed at the time of the test, shall be turned off.
6. Supply and return registers, if installed at the time of the test, shall be fully open.

Testing Company

Company Name: _____ Phone: _____

I hereby verify that the above Air Leakage results are in accordance with the 2020 7th Edition Florida Building Code Energy Conservation requirements according to the compliance method selected above.

Signature of Tester: _____ Date of Test: _____

Printed Name of Tester: _____

License/Certification #: _____ Issuing Authority: _____